

Test Report
No. 12-003047-PR01
(PB Z11-G03-04-en-01)



This is a translation of the test report (12-003047-PR01 PB Z11-G03-04-de-01)
dated 01. February 2013

Date 01. February 2013

Client C.C.E. srl
Costruzioni Chiusure Ermetiche
Via dell'Artigianato 16
35010 Villa del Conte (PD)
Italy

Order Determination of the sound reduction index R
according to
EN ISO 10140-1:2010 + A1:2012,
EN ISO 10140-2:2010;
Rating according to EN ISO 717-1 :
1996 + A1:2006

Object Floor seal type"13/28 ASTOP" in a high- per-
formance sound insulating doorset

Contents

- 1 Object
- 2 Procedure
- 3 Detailed results
- 4 Instructions for use

Data sheet (1 page)
Total 8 pages

1 Object

1.1 Description of test specimen

| | |
|---|--|
| Building element | Floor seal in a high-performance sound insulating doorset |
| Product designation | 13/28 ASTOP |
| Floor seal | floor drop seal, hinge-side activation, screw-fastened into sealing groove, mechanism with 2 contact pressure points |
| Dimensions of casing (Width / Height / Length) | 13 mm x 28 mm x 959 mm |
| Material of casing* | Aluminium |
| Material of gasket of floor seal * | PVC |
| Length of gasket | Corresponds to frame rebate dimensions at floor (the frame rebate dimensions - nominal opening width are: 966 mm) |
| Groove width | 13.0 mm |
| Groove depth | 28.0 mm |
| Position of the groove | between frame seal and door leaf seal |
| Air gap / travel of seal | 5.0 mm - 4.75 mm |
| Residual closing travel at start of activation | on lock side: 185 mm |
| Installation | floor seal screw fastened flush with groove platform |
| Floor | The floor seal operates against a flat steel bar |
| Joint depth | 57 mm |
| Doorset | Base leaf 47 mm multilayer door leaf with single rebate, overlap and frame seal. Reinforcements made from lead, sheet steel and heavy-duty bituminous material. Steel sheet lining on both sides, coated with heavy-duty bituminous material, resp. chip board, cavities filled with absorption material. Linings taper towards the floor joint |
| Size of door leaf | 985 mm x 1985 mm |
| Thickness of doorset | At top 200 mm, at bottom 57 mm |
| Seals | TPE cavity lip seal in frame and door leaf. Plastic sealant is applied to either side of seals at top and on sides. This side sealing starts at a height of 10 mm above floor. |
| Frame | Timber wrap-around frame |
| Design | 25 mm Multiplex reinforced with lead and sheet steel, connecting joint of frame fully filled with foam and sealed on either side with plastic sealant. |

The description is based on inspection of the test specimen at the **ift** Laboratory for Building Acoustics. Item designations/ numbers as well as material specifications were given by the client. (Further manufacturer data marked with *.)

1.2 Mounting in test rig

- The frame was mounted by the ift Laboratory for Building Acoustics flush with the source room side of partition's test opening of the door test rig „Z“, with suppressed flanking transmission according to EN ISO 10140-5:2010; the test rig features an insert frame with 5 cm continuous separating joint which is sealed in the test opening with permanently flexible closed-pore sealant.
- The high-performance sound insulation unit is described in Clause 1 "Object". The acoustic separation of the test rig was not bridged.
- The test opening was arranged with the bottom door edge being close to the floor.
- The door leaf was attached to the frame, both sides of the functional joint were additionally sealed on the sides (except side with 10 mm distance from bottom) and the top using elastic sealant, to prevent leakage through the functional joints at the top and the side.

1.3 Representation of test specimen

The structural details were examined solely on the basis of the characteristics to be classified. The illustrations are based on unchanged documentation provided by the client.

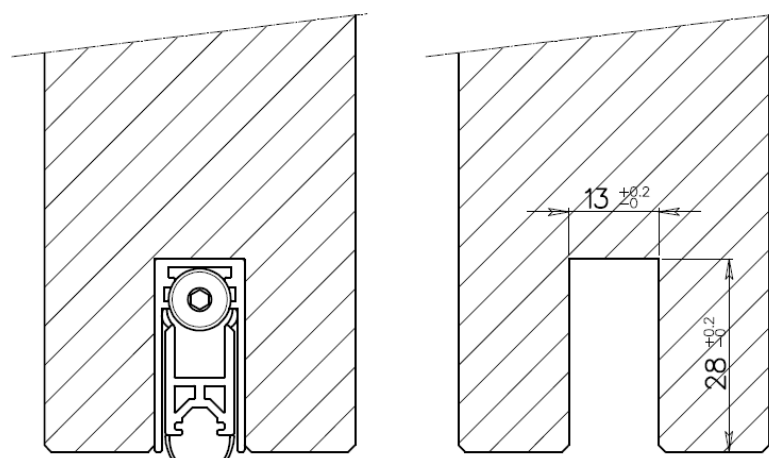


Figure 1 Sectional drawing 13/28 ASTOP



2 Procedure

2.1 Sampling

| | |
|--------------------------|--|
| Sampling | The samples were selected by the client. |
| Quantity | 1 |
| Manufacturer | CCE s.r.l. |
| Manufacturing plant | Villa del Conte (PD) |
| Date of manufacture / | 18th December 2012 |
| Date of sampling | |
| Responsible for sampling | Mr. Luca Geron |
| Delivery to ift | 16th January 2013 by the client |
| ift registration number | 33903/5 |

2.2 Procedure

| | |
|---------------------------|--|
| Goal of the investigation | Test of the acoustic suitability of a lowerable floor seal type " 13/28 ASTOP" for doors |
|---------------------------|--|

Basis

- EN ISO 10140-1:2010 + A1:2012 Acoustics; Laboratory measurement of sound insulation of building elements - Part 1: Application rules for specific products (ISO 10140-1:2010 + Amd.1:2012)
- EN ISO 10140-2:2010 Acoustics; Laboratory measurement of sound insulation of building elements - Part 2: Measurement of airborne sound insulation (ISO 10140-2:2010)
- EN ISO 717-1:1996 + A1:2006 Acoustics; Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation

Correspond/s to the national German standard/s:

DIN EN ISO 10140-1:2012-05, DIN EN ISO 10140-2:2010-12 and DIN EN ISO 717-1 : 2006-11

| | |
|---------------------|--|
| Boundary conditions | As specified by the standard requirements with the exception of the below stated deviations. |
|---------------------|--|

| | |
|------------|---|
| Deviations | The test setup was installed to determine the sound transmission through the floor joint. There fore a high-performance acoustic door leaf was mounted into a special frame and the top and side functional joints were sealed. The door element was in a non-functional condition. |
|------------|---|

| | |
|------------|------------|
| Test noise | Pink noise |
|------------|------------|

| | |
|------------------|------------------------------|
| Measuring filter | One-third-octave band filter |
|------------------|------------------------------|



| | |
|---------------------------------------|---|
| Background noise | The background noise level was not measured in the receiving room. No correction of sound insulation with background noise level was done. |
| Maximum sound insulation | Maximum sound insulation of the test setup for the floor seal was determined on the basis of the high-performance sound insulation door leaf described in Section 1. The difference between sound insulation and maximum sound insulation of the test setup is partly below 15 dB. It was corrected by calculation according to DIN EN ISO 10140-2 Annex A. The diagram annexed plots the maximum sound insulation. |
| Measurement of reverberation time | arithmetical mean: two measurements each of 2 loudspeaker and 3 microphone positions (total of 12 independent measurements). |
| Measurement equation A | $A = 0,16 \cdot \frac{V}{T}$ in m ² |
| Measurement of sound level difference | Minimum of 2 loudspeaker positions and rotating microphones |
| Measurement equation R | $R = L_1 - L_2 + 10 \cdot \lg \frac{S}{A}$ in dB |

LEGEND / KEY

| | |
|----------------|--|
| A | equivalent absorption area in m ² |
| L ₁ | Sound pressure level source room in dB |
| L ₂ | Sound pressure level receiving room in dB |
| R | Sound reduction index in dB |
| T | Reverberation time in s |
| V | Volume of receiving room in m ³ |
| S | Testing area of the specimen in m ² |

2.3 Test equipment

| Device | Type | Manufacturer |
|---------------------------|-----------------------------|---------------------|
| Integrating sound meter | Type Nortronic 840 | Norsonic-Tippkemper |
| Microphone preamplifiers | Type 1201 | Norsonic-Tippkemper |
| Microphone units | Type 1220 | Norsonic-Tippkemper |
| Calibrator | Type 1251 | Norsonic-Tippkemper |
| Dodecahedron loudspeakers | Own design | - |
| Amplifier | Type E120 | FG Elektronik |
| Rotating microphone boom | Own design / Type 231-N-360 | Norsonic-Tippkemper |

The **ift** Laboratory for Building Acoustics participates in comparative measurements at the Physikalisch-Technische Bundesanstalt (PTB) in Braunschweig every three years, the last one was in April 2010. The sound level meter used, Series No. 24842, was calibrated by the Dortmund Eichamt (calibration agency) on 20th January 2011. The calibration is valid until 31 December 2013.

2.4 Testing

| | |
|---------------|-------------------|
| Date | 16th January 2013 |
| Test engineer | Andreas Preuss |

3 Detailed results

The values of the measured sound reduction index of the high-performance sound insulating doorset with the tested floor seal are plotted as a function of frequency in the annexed data sheet and tabled.

As per EN ISO 717-1 the weighted sound reduction index R_w and the spectrum adaptation terms C and C_{tr} for the frequency range 100 Hz to 3,150 Hz obtained by calculation are as follows:

$$R_w (C; C_{tr}) = 42 (-1; 0) \text{ dB}$$

According to EN ISO 717-1 the following additional spectrum adaptation terms are obtained:

| | | | | | | | | |
|------------------|---|-------|-------------------|---|------|------------------|---|------|
| $C_{50-3150}$ | = | -1 dB | $C_{100-5000}$ | = | 0 dB | $C_{50-5000}$ | = | 0 dB |
| $C_{tr,50-3150}$ | = | 0 dB | $C_{tr,100-5000}$ | = | 0 dB | $C_{tr,50-5000}$ | = | 0 dB |



4 Instructions for use

The **ift guidance** sheet "Conditions and notes for the use of **ift** test documents" applies.

4.1 Validity

The data and results given relate solely to the tested and described specimen. Testing for sound insulation does not allow any statement to be made on any further characteristics of the present construction regarding performance and quality.

4.2 Test report is not an evidence of suitability/verification of applicability

This test report is not an evidence of suitability/verification of applicability as per DIN 4109:1989-11. It does not contain a calculated value.

4.3 Test standards

The standard series EN ISO 10140:2010 supersedes those, until the respective date, applicable parts of the standard series EN ISO 140 which describe laboratory tests. According to the two standard series, the test methods are identical.

ift Rosenheim
01. February 2013

Handwritten signature of Joachim Hessinger in blue ink.

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Physics

Handwritten signature of Andreas Preuss in blue ink.

Andreas Preuss, Dipl.-Ing. (FH)
Laboratory manager
Building Acoustics

Sound reduction index according to ISO 10140 - 2

Laboratory measurements of airborne sound insulation of building elements



Client: C.C.E. srl

Costruzioni Chiusure Ermetiche, 35010 Villa del Conte (PD) (Italy)


Product designation 13/28 ASTOP

Design of test specimen

| | | |
|---|---|---|
| Floor seal in a high-performance sound insulating doorset | Test date | 16th January 2013 |
| Dimensions of casing (w x h x l) | Test opening | 1.01 m x 2.01 m = 2.03 m ² |
| 13 mm x 28 mm x 959 mm | Partition wall | Concrete double wall, insert frame |
| Activation | Test noise | pink noise |
| hinge-side | Volumes of test rooms | V _s = 101 m ³ V _r = 67.5 m ³ |
| Air gap / travel of seal | Maximum sound reduction index | R _{w,max} = 59 dB (related to test surface) |
| 5.0 mm - 4.75 mm | Mounting conditions | Floor seal mounted into an ideal sound insulating door leaf |
| Length of gasket | Corresponds to frame rebate dimensions at floor | |
| Dimensions of groove | 13.0 mm x 28.0 mm | |
| Mounting | floor seal screw fastened flush into sealing groove | |
| | Climate in test rooms | 18 °C / 36 % RF / 949 hPa |

| f in Hz | R in dB |
|---------|---------|
| 50 | 34.0* |
| 63 | 36.5* |
| 80 | 43.5* |
| 100 | 47.3* |
| 125 | 45.0* |
| 160 | 45.0* |
| 200 | 45.4* |
| 250 | 43.7 |
| 315 | 46.9 |
| 400 | 44.8 |
| 500 | 44.6 |
| 630 | 44.3 |
| 800 | 44.8 |
| 1000 | 44.2 |
| 1250 | 43.6 |
| 1600 | 40.8 |
| 2000 | 38.1 |
| 2500 | 37.9 |
| 3150 | 41.5 |
| 4000 | 44.5 |
| 5000 | 46.6 |

* = Correction with maximum sound reduction
Difference ≤ 6dB

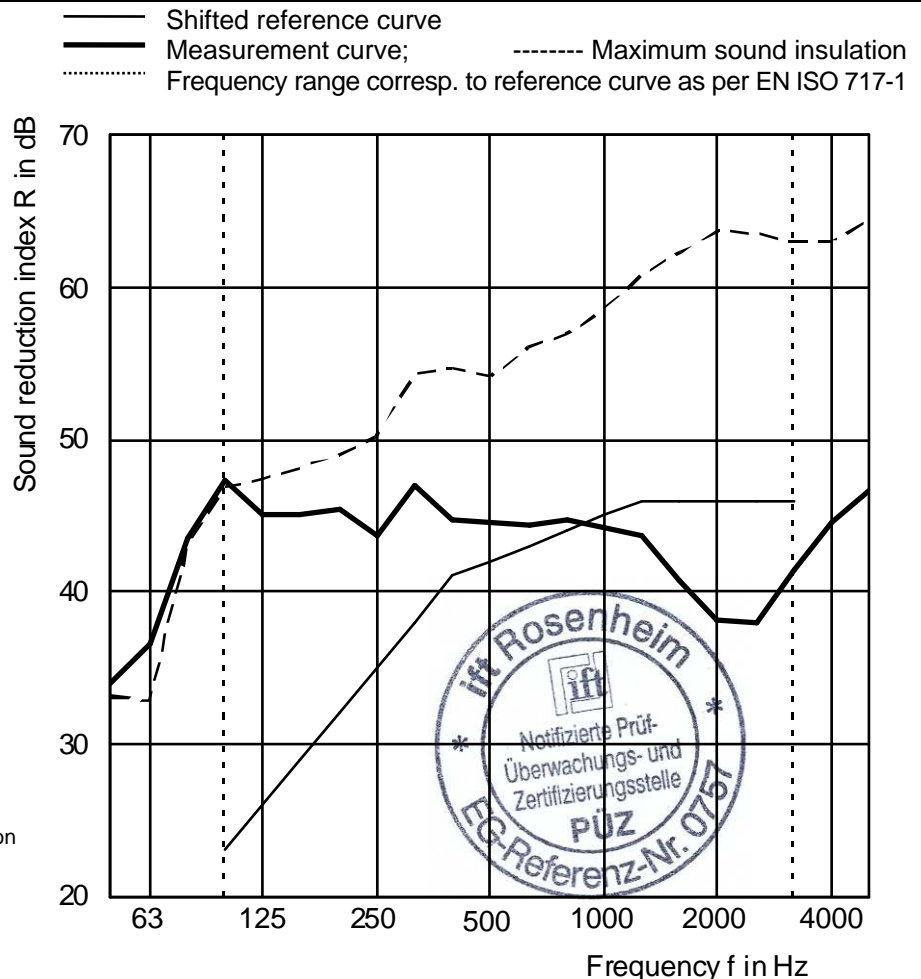

Rating according to EN ISO 717-1 (in third octave bands):

R_w (C;C_{tr}) = 42 (-1;0) dB C₅₀₋₃₁₅₀ = -1 dB; C₁₀₀₋₅₀₀₀ = 0 dB; C₅₀₋₅₀₀₀ = 0 dB
 C_{tr,50-3150} = 0 dB; C_{tr,100-5000} = 0 dB; C_{tr,50-5000} = 0 dB

Test report No.:12-003047-PR01 (PB Z11-G03-04-en-01)

Page 8 of 8

ift Rosenheim, Laboratory for Building Acoustics
 01. February 2013

Andreas Preuss, Dipl.-Ing. (FH)
 Laboratory manager Building Acoustics